

Date: 2001-07-13

Interface Specification

LBRC CRYO-ASSEMBLIES – D2 DIPOLES

Abstract

The superconducting D2 magnet consists of an LBRC cryo-assembly containing an MBRC magnet. Eight LBRC cryo-assemblies, plus one spare, will be built. The installation locations are IP1L, IP1R, IP2L, IP2R, IP5L, IP5R, IP8L, and IP8R. This document specifies the interfaces of the LBRC cryo-assemblies to the MQY (Q4) quadrupole, the QRL cryogenic transfer line, the CERN provided beam screen and warm-to-cold transition, support jacks, and alignment systems.

Prepared by :

S. Plate

BNL

Plate@bnl.gov

Reviewed by :

E. Willen

BNL

Willen@bnl.gov

J. Strait

FNAL

Strait@fnal.gov

Approved by :

T. Taylor

tom.taylor@cern.ch

History of Changes

Rev.	Date	Pages	Description of Changes
1.0	2000-11-17		Initial submission
1.1	2001-01-19	4	Added reference to BNL cold bore tube specification.
		9	Added size of reserved space for welding and cutting.
		13, 14	Revised quench heater wire size. Added liquid level sensor wires.
		23	Added LHC drawings numbers.
2.0	2001-06-11	6	Table 1: Added 18 mm to lead end of cryostat. Changed cold mass length from 10386 to 10400 to accommodate lack of weld shrinkage in production.
		9	Added text regarding IFS coming out through cryostat wall.
		10-11	Tables 2 & 3: Changed i stub to BNL interface. Changed e_1 stub size from 87.0 x 3.5 to 17.2 x 1.0. Changed Y coordinate of e_1 and e_2 from +/-199 to +/-56. Changed Z coordinates of i, e_1 , e_2 , t from 193.0, -288.0, -239.4, 237.8 to -193.0, -290.0, -320.5, 226.3 respectively. Changed X coordinate of t from +/-76.2 to +/-105.6.
		14	Table 5: Corrected level probe wire size from 26AWG to 32AWG.
		17	Removed c' from QQS (no longer required). Altered Fig 8 etc. accordingly.
		19	Table 7: Corrected cold motion of e_2 at NLE from 16 mm to 21 mm to match correct anchor location.
		20	Figure 9: Changed vacuum vessel length from 10260 to 10278. Added 177 mm dimension from cold mass virtual plane to QQS/Dome joint flange for reference.
		21	Table 8: Changed cold bore tube Y coordinate from 10456 to 10470 to reflect longer cold mass.
2.1	2001-06-19	17	Figure 8: Revised cold mass length from 10.386 m to 10.400 m.
2.1	2001-07-13	all	Released version

Table of Contents

1. INTRODUCTION	4
2. GENERAL SPECIFICATIONS.....	5
3. GENERAL LAYOUT	6
3.1 CRYO-ASSEMBLY CROSS SECTION	6
3.2 LOCAL COORDINATE SYSTEM	7
3.3 PIPING.....	8
4. LBRC – MQY (Q4) INTERFACES	9
4.1 TUBE COORDINATES	9
4.2 ELECTRICAL CONNECTIONS	13
5. LBRC – QRL INTERFACE	16
5.1 INTERFACE PLANES	17
5.2 TUBE POSITIONS	18
6. LBRC – NON-LEAD END INTERFACES	20
6.1 COLD BORE TUBE, BEAM SCREEN AND WARM-TO-COLD TRANSITION	20
6.2 TUBE POSITIONS	21
7. LBRC – TUNNEL FLOOR INTERFACES.....	22
8. LBRC – ALIGNMENT SYSTEM INTERFACES	23
9. LIST OF DRAWINGS	24
10. REFERENCES	24

1. INTRODUCTION

Each superconducting D2 dipole cryo-assembly (LBRC) will be a dual aperture, RHIC-type coil in single cold mass [1,2,3]. The D1 and D2 magnets bring the two beams of the LHC, separated by 194 mm in the arcs, into collision at four separate points, then separate the beams again beyond the collision point. D2 magnets (MBR) are located on each side of IPs 1, 2, 5 and 8, eight total, plus one spare. One side of one such region is shown in Figure 1. Superconducting D1 (MBX) magnets will be used on each side of IPs 2 and 8. For IPs 1 and 5, warm D1 magnets (MBXW) are planned. This specification refers only to the D2 magnets (MBRC) in cryo-assemblies (LBRC). D2 magnets operate at 4.5K in two-phase helium.

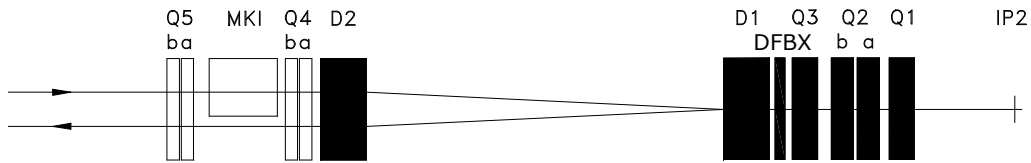


Figure 1 Geometry in Intersection Region 2 of the LHC. Dipole magnets D1 and D2 bring the beams into collision at IP2.

The configurations of the eight D2 cryo-assemblies are identical, with the exception of the QQS attached to D2 (addressed later in section 5.1). Magnet D2 and adjacent CERN-built magnet Q4 are connected together to form a cryogenic module. The operation and instrumentation specific to D2 takes this into account. One spare is built to replace any of the eight production units.

2. GENERAL SPECIFICATIONS

The LBRC cryo-assembly uses two collared coils in one steel yoke contained in a stainless steel shell (2-in-1 cold mass). The yoke is slightly wider than it is high, giving an oblate shape to the cold mass. There is one such cold mass in an LBRC cryo-assembly. The cryostat for D2 is 914mm (36 in) in diameter, the same as the LHC arc dipole. Table 1 contains a summary of the LBRC parameters.

Table 1 Specifications of the LBRC Cryo-assemblies

Item	Value
Quantity + (Spares)	8 + (1)
Operating Temperature	4.5 K
Cold Bore Tube[4] OD / ID	73 / 69 mm
Beam Dynamic Heat Load	Active Beam Screen
Coil Prestress Application	Collar
Cold Mass Design	2 in 1
Bore Spacing	188 mm
Yoke Size	550 mm x 625 mm
Shell Thickness	9.5 mm (0.375 in)
End Plate Thickness	70 mm (2.75 in)
Cold Mass Length (endplate – endplate)	9.814 m (386.4 in)
Cold Mass Length (end volume – end volume)	10.400 m (409.4 in)
Cold Mass per Cryostat	1
Cryostat Length (incl QQS)	10.278 m (404.6 in)
Cryostat Diameter	914 mm (36 in)

3. GENERAL LAYOUT

3.1 CRYO-ASSEMBLY CROSS SECTION

The LBRC (D2) cryo-assembly cross section at a support post location, as viewed from the lead end, is shown in Figure 2.

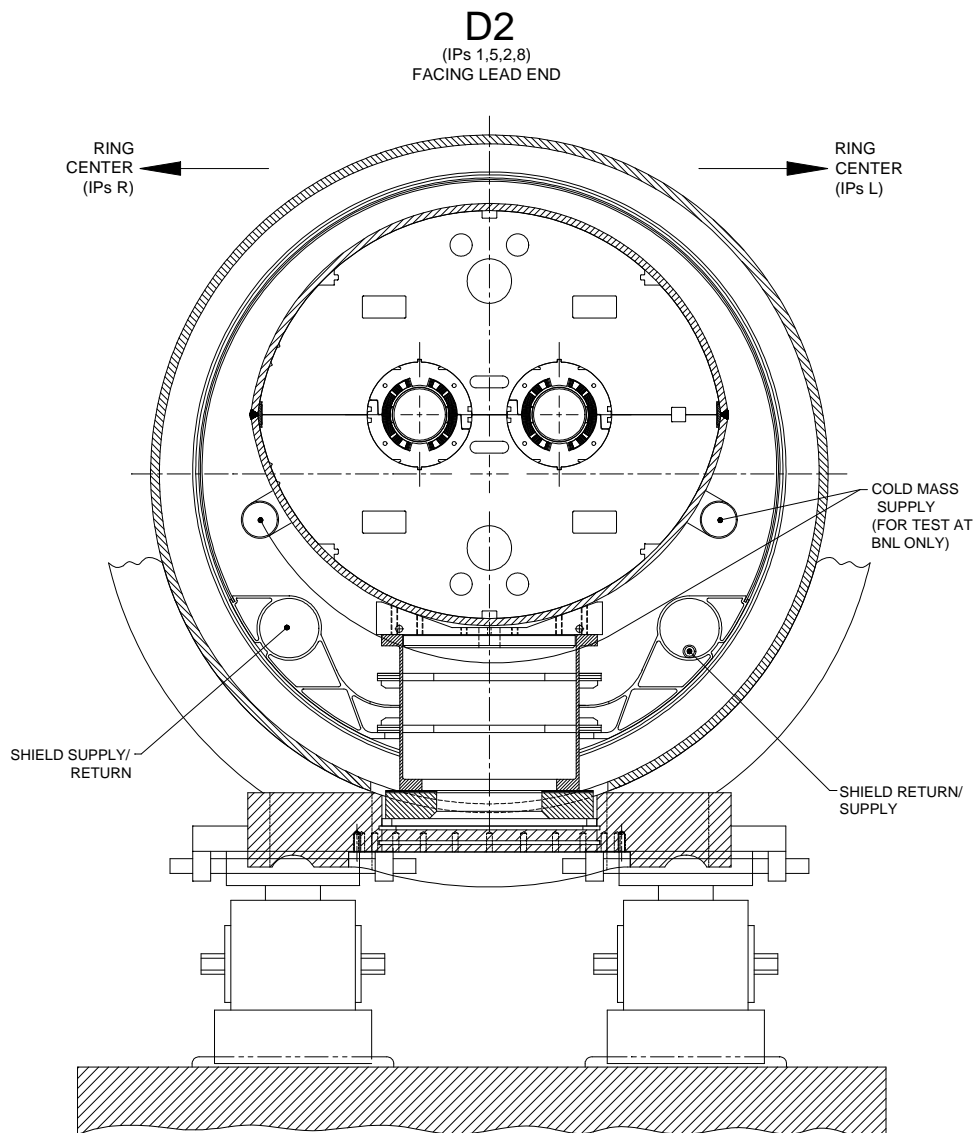


Figure 2 Cross Section of the D2 (LBRC) Cryo-assembly at a support post location, viewed from the lead end of the magnet.

3.2 LOCAL COORDINATE SYSTEM

Figure 3 shows the LBRC local coordinate system which is similar to the LHC standard for local coordinate systems [5] except that the origin is always located at the lead end for each D2. The XZ plane ($Y=0$) is coincident with the restraint flats welded to the dome and referenced in specification LHC-LI-ES-0001[6] and is centered between the two cold bore tubes. Positive X always points toward the LHC ring center.

The coordinate system is defined in the same way for both warm and cold conditions, i.e. it is fixed on the lead end of the cold mass. This results in a displacement of the coordinate system due to thermal contraction of the cold mass. The cold origin is displaced 0.8 mm in the negative Z-direction (down) with respect to the warm position. It is displaced 16 mm in the positive Y-direction for a magnet on the left side of the IP and 16 mm in the negative Y-direction for a magnet on the right side.

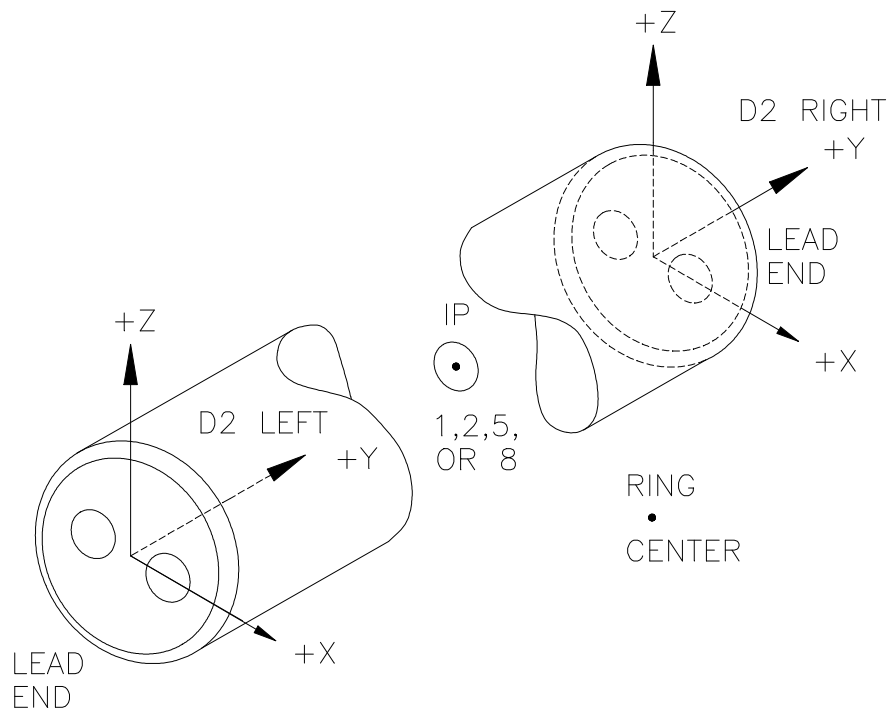


Figure 3 Local coordinate system for LBRC. The flat surface shown at the lead end is schematic only; it represents interconnect planes "L/C" as defined by the restraint flats welded to the dome and referenced in specification LHC-LI-ES-0001. [6]

3.3 PIPING

The longitudinal sections in Figure 4 show the piping required inside the cryostat, with the top of the cryostat removed for clarity. Figure 5 shows transverse and longitudinal views of the lead end of the magnet and cryostat. Lower case letters are used to label the pipes and tubes that BNL has designed into the system, and these letters correspond (where applicable) to the header pipes, labelled in upper case letters on the CERN cryogenic flow diagrams, to which the magnet piping eventually connects. These sections also show the tubing stubs protruding from the end volumes of the cold mass. Tubing stubs are needed to admit liquid helium, vent gaseous helium, and convey buses through liquid helium to the source of electrical power. The details of the cooling system are described in [7].

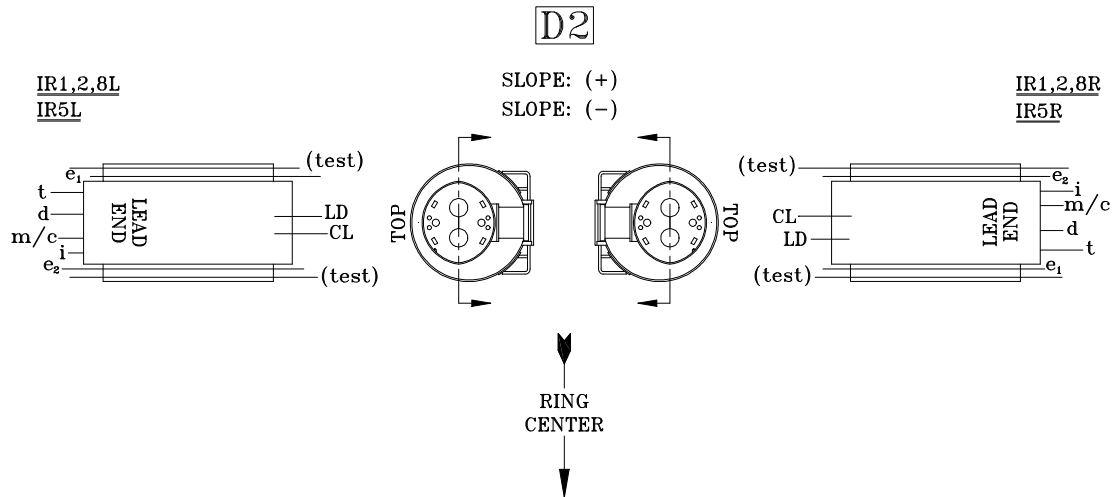


Figure 4 Piping within the cryostat

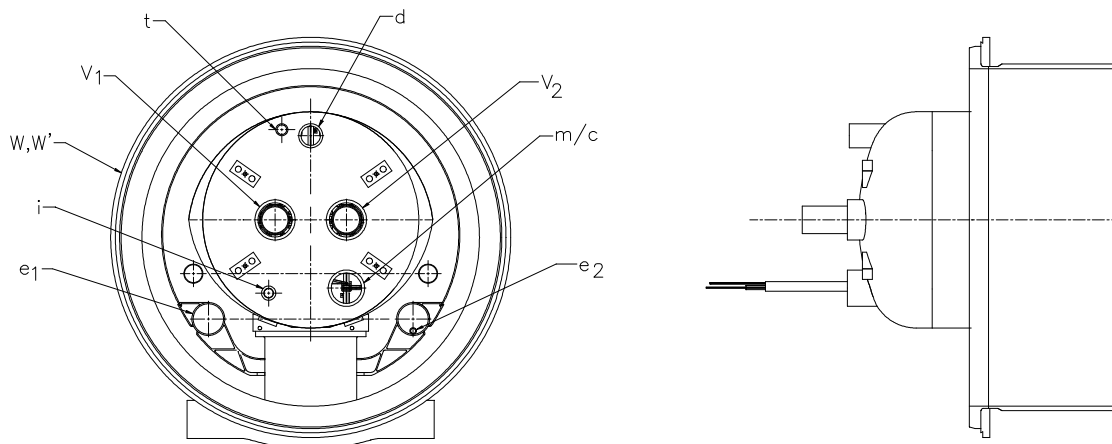


Figure 5 Cryogenic connections at the lead end volume.

Coming out of the cold mass end volumes there are five tubing stubs, three at the lead end and two at the non-lead end, labelled m/c, d, i, CL, and LD. There is also an additional stub at the lead end labelled t used only for cold testing at BNL; it will be capped before the magnet is shipped to CERN. Stubs labelled CL are used to admit liquid helium into the cold mass either in cooldown mode or steady state mode. Stubs labelled d and LD are used as vents to return helium gas, collected in the top of the end volume, to the cryogenic system, sometimes via Q4. The m/c stub at the lead end provides a tube for the D2 powering bus to connect to a bus in Q4 as well as for the liquid helium in the two adjacent magnets to freely communicate during fill and steady state conditions.

The i stub is provided for the instrumentation leads to exit the end volume. An instrumentation feedthrough system (IFS) is attached by BNL to the i stub; CERN does not interface to it directly. The IFS is a copy of the CERN design to the extent possible. It exists the cryostat in the standard way, but there are notable exceptions: the stainless tube is larger in diameter, there is a flex hose section above the thermalisation point to accommodate cold mass insertion into the vacuum vessel, and the 40-pin feedthrough plate is attached by CERN after magnet shipment.

The sizes of the stubs, shown in Tables 2 and 3, are based on the venting requirements of the D2 magnet and the cryogenically connected Q4 magnet. The lead end stubs emanate from the domed face of the end volume. This is indicated schematically by showing the line representing them beginning at the end of the cold mass. The non-lead end stubs connect to the cylindrical portion of the end volume at the top. This is indicated schematically by showing the line representing them extending over the top of the cold mass a short distance.

Shown within the cryostat are the shield supply and return pipes labelled e_1 and e_2 . Pipe e_1 is the shield pipe which is an integral part of the CERN-supplied heat shield extrusion and is therefore thermally connected to the shield. Pipe e_2 is a stainless steel line inserted within the shield and intentionally thermally isolated somewhat from it to prevent cooling instability. Cooling gas can enter either e_1 or e_2 first, and return through the other, without affecting shield function.


4. LBRC – MQY (Q4) INTERFACES

The lead end of the cold mass always faces away from the IP and connects to the CERN-supplied Q4 magnet. The D2-Q4 cryogenic pair is "turned" as a unit for left side and right side of the IP installations. Therefore all interconnects between the pair remain unchanged.

4.1 TUBE COORDINATES

Since the D2-Q4 pair is rotated from one side of the IP to the other and directions of the axes in the local coordinate systems are the same on both sides of the IP, the signs of the coordinate positions of the tubes change in many cases. The sizes of the various tubing stubs for the D2 magnet and their warm coordinate positions on the left and right sides of the IP are shown in Tables 2 and 3 respectively. Welding and cutting clearances have been taken into account in positioning these tubes so that there exist 50 mm radial and 60 mm axial clearance envelopes around each pipe.

Table 2 Warm coordinate positions for the D2 lead end on the left side of the IP. Most pipes are in standard US sizes with transitions to terminate at the interface in standard metric sizes.




Name	Description	OD x Wall	Warm Coordinates					
		Tube (mm)	X (mm)		Z (mm)		Y (mm)	
V1	Cold bore tube, left aperture	73 x 1.9	-94.2	±1	0.0	±1	-60.0	±2
V2	Cold bore tube, right aperture	73 x 1.9	94.2	±1	0.0	±1	-60.0	±2
d	Helium gas vent	50.8 x 2.1	0.0	±2	222.0	±2	-90.0	±2
		102.0 x 1.65 ^a						
m/c	Bus/helium	63.5 x 1.65	111.0	±1	-193.0	±1	-90.0	±2
		102.0 x 1.65 ^a						
i	Instrumentation	BNL interface only	-111.0	±2	-193.0	±2	-90.0	±2
e ₁	Heat shield sup/ret (conn)	17.2 x 1.0	-270.0	±2	-290.0	±2	56.0	±2
		87.0 x 3.5 ^b						
e ₂	Heat shield ret/sup (isol)	17.2 x 1.0	270.0	±2	-320.5	±2	56.0	±2
		19.0 x 1.65 ^b						
t	Helium supply (BNL test only)	Capped	-105.6	±2	226.3	±2	-40.0	±2
W	Cryostat (rotatable flange)	1055 x 61.5	0.0	±3	-80.0	±3	329.0	±3
W'	Cryostat (flange mount)	1008 x 59.0	0.0	±3	-80.0	±3	299.0	±3

Note a: Dimensions of flanges welded to tubes. The flanges, when they are present, are located at the interface.

Note b: Dimensions of tube behind interface. A transition section is used to reach the interface dimension of 17.2 x 1.0.

Table 3 Warm coordinate positions for the D2 lead end on the right side of IP. Most pipes are in standard US sizes with transitions that terminate at the interface in standard metric sizes.



Name	Description	OD x Wall Tube (mm)	Warm Coordinates					
			X (mm)		Z (mm)		Y (mm)	
V1	Cold bore tube, left aperture	73 x 1.9	94.2	±1	0.0	±1	60.0	±2
V2	Cold bore tube, right aperture	73 x 1.9	-94.2	±1	0.0	±1	60.0	±2
d	Helium gas vent	50.8 x 2.1	0.0	±2	222.0	±2	90.0	±2
m/c	Bus/helium	102.0 x 1.65 ^a	-111.0	±2	-193.0	±2	90.0	±2
		63.5 x 1.65						
i	Instrumentation	102.0 x 1.65 ^a BNL interface only	111.0	±2	-193.0	±2	90.0	±2
e ₁	Heat shield sup/ret (conn)	17.2 x 1.0	270.0	±2	-290.0	±2	-56.0	±2
e ₂	Heat shield ret/sup (isol)	87.0 x 3.5 ^b	-270.0	±2	-320.5	±2	-56.0	±2
		17.2 x 1.0						
		19.0 x 1.65 ^b						
t	Helium supply (BNL test only)	Capped	105.6	±2	226.3	±2	40.0	±2
W	Cryostat (rotatable flange)	1055 x 61.5	0.0	±3	-80.0	±3	-329.0	±3
W'	Cryostat (flange mount)	1008 x 59.0	0.0	±3	-80.0	±3	-299.0	±3

Note a: Dimensions of flanges welded to tubes. The flanges, when they are present, are located at the interface.

Note b: Dimensions of tube behind interface. A transition section is used to reach the interface dimension of 17.2 x 1.0.

All of the tubes move due to cooldown from 300 K to 4.3 K. The changes in position are expressed as a combination of two movements. One movement is that of the origin of the coordinate system, Figure 3. which is centered between the two beam tubes and moves down due to the shrinkage of the cold mass and the support posts. The origin is displaced 0.8 mm in the negative Z-direction (downward) and 16 mm toward the center of the magnet in the Y-direction upon cooldown. The movements of pipes and the cold mass reflect the fact that all are fixed to the cryostat at the longitudinal midpoint, unless otherwise stated.

The other movement of each tube is with respect to the origin. That movement is described in Table 4 for each tube. Tubes V1, V2, d, and m/c all move in a similar manner due to the shrinkage of stainless steel and their movements are expressed as a percentage of their distance from the origin. Heat shield tubes e_1 and e_2 move due to a combination of material shrinkages and their movements are expressed as explicit distances toward (or away from) the origin.

Table 4 Cold changes in position at the D2 lead end on both sides of the IP. The origin has been displaced 0.8 mm in the negative Z-direction and 16 mm toward the center of the magnet in the Y-direction upon cooldown. All pipes and the cold mass are fixed to the cryostat at the longitudinal midpoint, unless otherwise stated.

Name	Description	Change in Position With Respect to the Origin
V1	Cold bore tube, left aperture	X: moves 0.3% toward origin.
V2	Cold bore tube, right aperture	Z: moves 0.3% toward origin.
d	Helium gas vent	Y: moves 0.3% toward origin.
m/c	Bus/helium	
e_1	Heat shield sup/ret (conn)	X: moves 0.4% (1.1 mm) toward origin. Z: moves 0.2 mm toward origin. Y: moves 4 mm away from origin. (Net movement is 20 mm toward cold mass center.)
e_2	Heat shield ret/sup (isol)	X: moves 1.1 mm toward origin. Z: moves 0.2 mm toward origin. Y: moves 6 mm toward origin. (Net movement is 10 mm toward cold mass center.)

4.2 ELECTRICAL CONNECTIONS

Figure 6 is a schematic diagram of the main power to the D2 magnet coils. Labelling of the terminals follows the convention specified in [8].

A bus/flex joint assembly of BNL design will be used in the lead end volume to accommodate expansion and contraction of the short powering bus connected to the Q4 through-bus (Figure 7). The electro-mechanical design inside the end volume will connect the two collared coils in series to the bus/flex joint assembly (see Figure 6).

Instrumentation supplied in D2 is shown in Table 5. All instrumentation and control wiring is routed along and lashed to the flex joint, with expansion loops between terminations and the flex joint lash point to provide for differential thermal contraction internal to the magnet. The wiring exits the end volume through the i stub into the IFS (instrument feedthrough system described in section 3.3), separating from the main power buswork on the flex joint within the end volume.

There are two temperature sensors located within the cold mass on the outside of the yoke near the longitudinal center. One of these sensors is redundant. Temperature sensors are the short type thermometer assemblies (36 mm x 12 mm x 4.2 mm) typically used by CERN [9]. The sensors are calibrated and supplied to BNL by CERN.

The 3-wire voltage tap cables consist of three Tefzel-over-Kapton insulated wires within an outer helical wrap of 0.04 mm thick Kapton. The voltage tap leads are soldered to the "A" and "B" leads, to the coil lead splice between apertures, and to the crossover splice between upper and lower coils for each aperture, as close as possible to the lead end of the coils. Tefzel is used only as a convenience for color coding and Kapton retention; no credit is taken for insulating properties.

The quench protection heater leads power the heaters in two independent circuits to create a level of redundancy in case of failure in one circuit. Two yoke warm-up heaters are located within the lead end volume.

All D2 magnets have helium level sensors provided in the non-lead end volume which are used to control cryogenic operation of the D2-Q4 pair. Two sensors are provided for redundancy. Where the D2 is lower than the Q4 the level sensors in D2 are not used, that function being controlled by the sensors in Q4. A level third sensor is at the lead end and is only needed during operation of the magnet on the test stand at BNL. The leads for this sensor must be terminated to prevent shorts and are included in Table 5, but they are not active.

Table 5 *Instrumentation and control wiring exiting the cold mass through the i stub. The external lengths are measured from the end volume plane ($y=0$).*

Lead	Length	Description
Temperature sensors	1 m	2 twisted quads (total 8 wires, #32 AWG.)
Voltage taps	1 m	4 cables (3-#28 AWG wires each) red = "A" coil lead black = "B" coil lead yellow = upper/lower coil crossover joint
Quench heaters	1 m	4 wires, #22 AWG
Warm-up heater	1 m	2 twisted pairs (total 4 wires, #26 AWG.)
Liquid Level Sensors	1 m	3 twisted quads (total 12 wires, #32 AWG.)

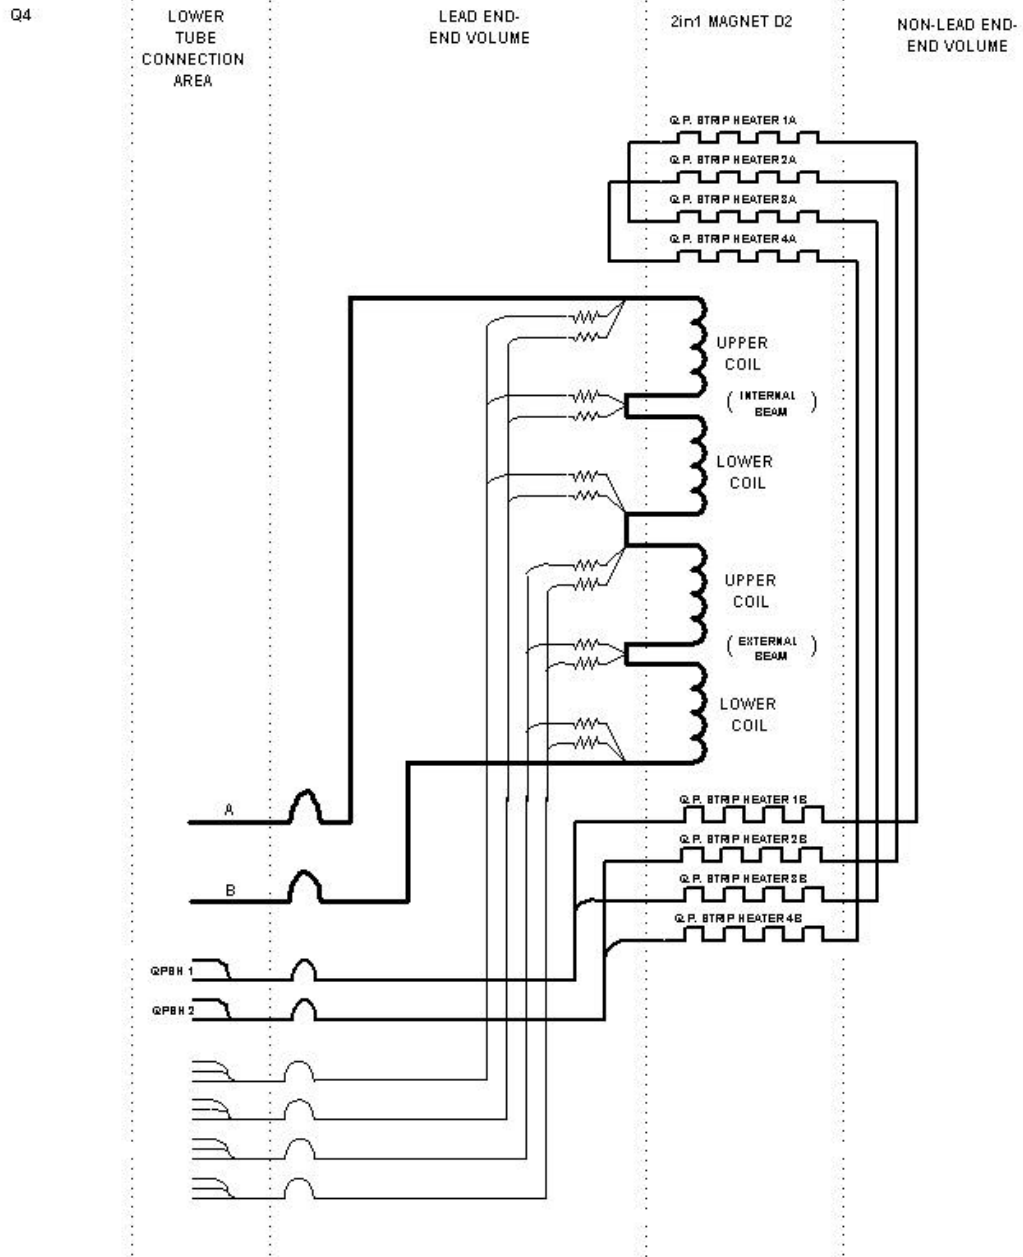


Figure 6 *Electrical schematic of power leads for the D2 magnet.*

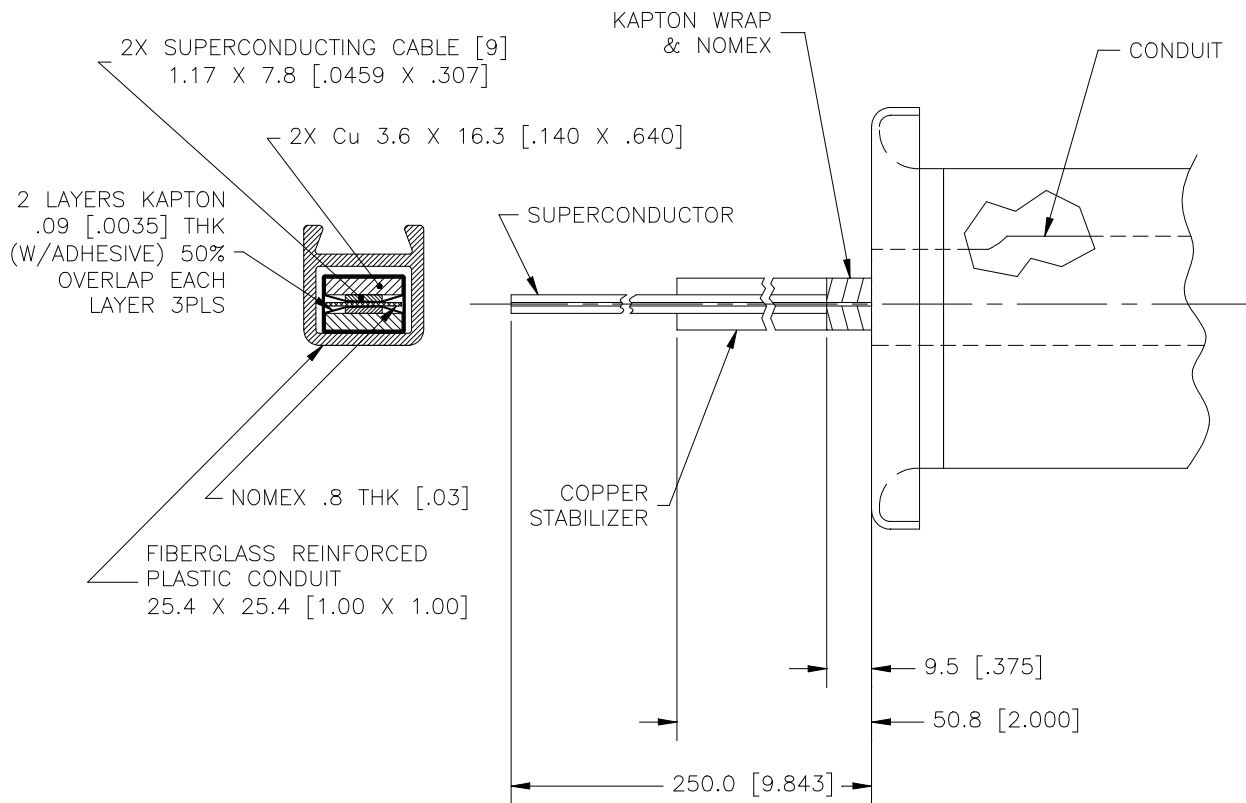


Figure 7 Busbar interface at existing m/c bus. Dimensions are given in mm [inches].

5. LBRC – QRL INTERFACE

A QQS service module is connected to the non-lead end of D2. Helium for the D2/Q4 cryogenic pair is supplied and returned through this QQS and another at the far end of Q4. A left side D2/Q4 pair is essentially "turned" end for end to make a right side pair. However, the QRL cryogenic transfer line, to which the QQS attaches, is always located toward the outside of the tunnel. The impact on the D2 design is that there must be four D2 magnets built with a left-facing QQS, and four more with a right-facing QQS. However, the positions and functions of the pipes at the interface to the QRL will be identical for both types as viewed from the ring center. This is accomplished through internal plumbing changes unique to each type which provide the correct interface arrangement.

BNL is responsible for integrating the QQS into the construction of the D2 magnet. The D2 cryostat will therefore include an extension and riser for the exiting QQS piping. The shipped length of the resulting magnet assembly will be less than 10.7 m to allow shipment inside a standard 40 ft container. The cryostat will have mechanical seals at both ends.

Since the spare magnet must be capable of being installed in either left or right sides, its QQS is shipped as a partially complete assembly plus a kit of parts. When a spare is needed, CERN will complete the QQS for that specific ring location using the parts provided.

5.1 INTERFACE PLANES

The configuration of the QQS internal plumbing is shown in Figure 8. The positions of the pipes at the interface to the QRL is defined with respect to Plane Q as defined in Figure 8. As with the main local coordinate system defined in section 3.2 (plane "C" in Figure 8), the Y-axis is in the clockwise beam direction, the X-axis points towards the center of the ring, and the Z-axis completes the right-hand coordinate system. At room temperature the origin of the "Q" coordinate system is translated from that of the "C" coordinate system +684.5 mm in Z, 0 mm in X, and +10315 mm in Y (left side of the IP) or -10315 mm in Y (right side of the IP).

The interface to the QRL is identical for both left and right magnets as viewed from the ring center. The origin of Plane Q is defined such that the "z" positions of e_1 & e_2 remain on the horizontal centerline of the origin after cooldown.

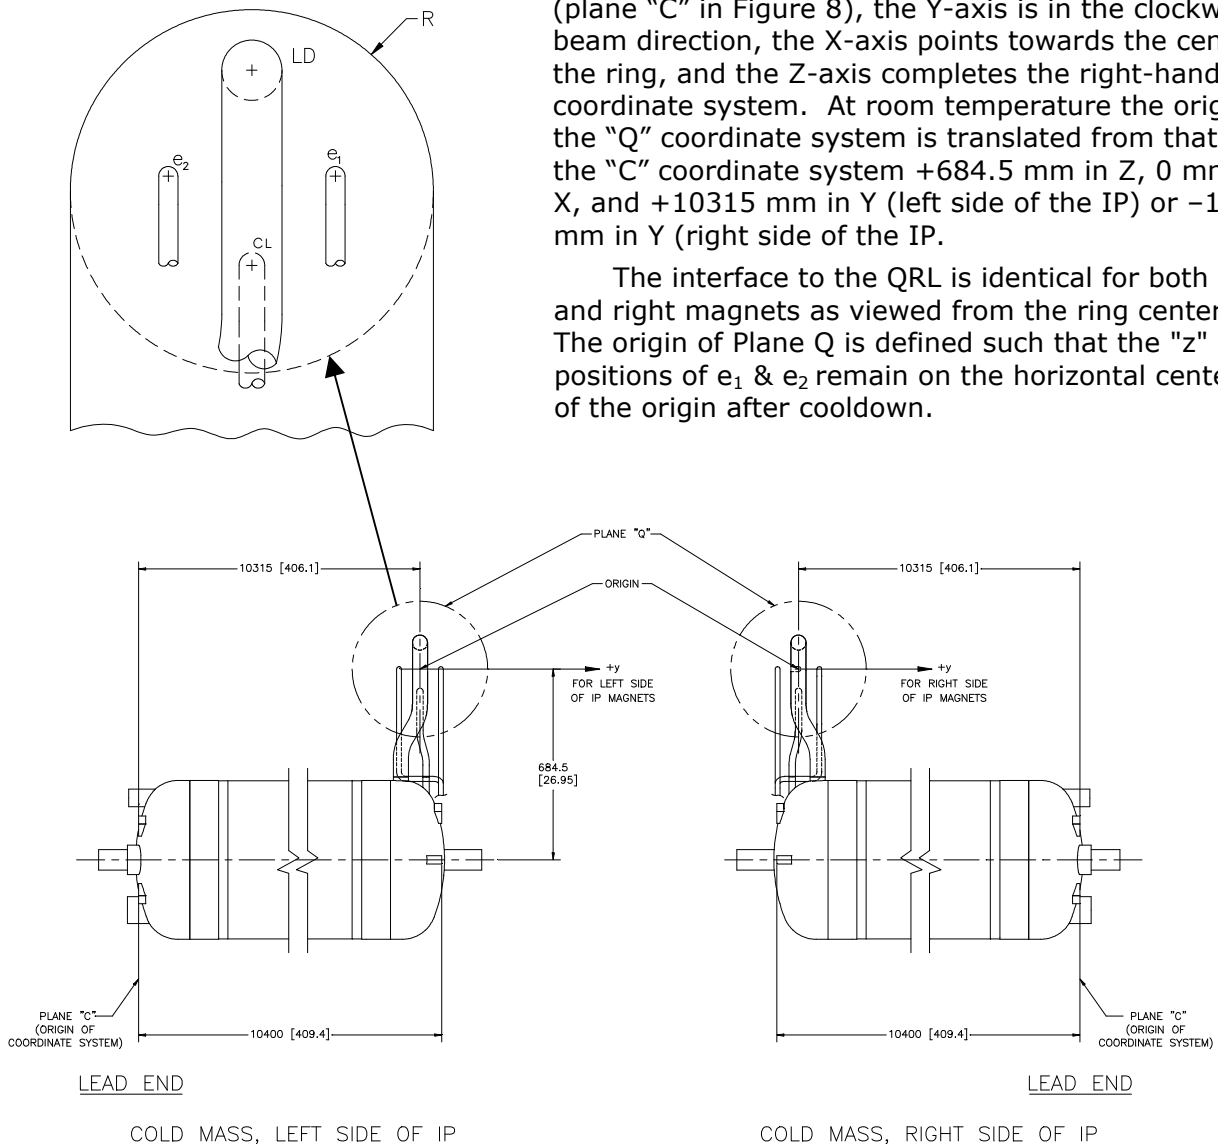


Figure 8 Interface Planes "Q" and "C" viewed from inside the ring. The warm dimensions in mm [inches] are shown. "X" is positive out of the page.

5.2 TUBE POSITIONS

The sizes of the various tubes for the QQS and their warm coordinate positions are shown in Table 6. The QQS has been designed so the tube positions are the same on both sides on the IP. Their movements in position due to cooldown are shown in Table 7.

Table 6 *Warm coordinate positions of pipes at the QQS-QRL interface on both sides of the IP. Positions are expressed with respect to interface plane "Q" as defined in Figure 8.*

Name	Description	OD x Wall	Warm Coordinates					
		Tube (mm)	X (mm)		Z (mm)		Y (mm)	
LD	Helium gas vent	64.0 x 2.0 ^a 50.8 x 1.65 ^b	-301.0	±2	95.0	±2	0.0	±2
CL	Helium supply	23.0 x 1.5	-367.0	±2	-80.0	±2	0.0	±2
e ₁	Heat shield sup/ret (conn)	17.2 x 1.0	-367.0	±2	0.0	±2	75.0	±2
e ₂	Heat shield ret/sup (isol)	17.2 x 1.0	-367.0	±2	0.0	±2	-75.0	±2
R	QQS vacuum enclosure	380.0 x 26.5 ^a 335.0 x 4.0 ^b	-223.0	±2	0.0	±2	0.0	±2
S	QQS heat shield	277.0 X 2.0	-253.0	±2	0.0	±2	0.0	±2

Note a: Dimensions of flange welded to tube.

Note b: Dimensions of tube behind flange.

Table 7 *Cold changes in position of pipes at the QQS-QRL interface on the both sides of the IP. The origin of plane "Q" has been displaced 2.0 mm in the negative Z-direction (down) and 16 mm in the Y-direction (toward the magnet center) upon cooldown with respect to the magnet center.*

Name	Description	Changes
LD	Helium gas vent	X: moves 1 mm toward origin (cold mass center)
CL	Helium supply	Z: no movement within coordinate system, origin moves 2 mm toward cold mass center
e ₁	Heat shield sup/ret (conn)	Y: no movement within coordinate system, origin moves 16 mm toward cold mass center
e ₂	Heat shield ret/sup (isol)	X: moves 1 mm toward origin (cold mass center) Z: no movement within coordinate system, origin moves 2 mm toward cold mass center Y: moves 5 mm away from origin, origin moves 16 mm toward cold mass center, net movement is 21 mm toward cold mass center
S	QQS heat shield	X: moves 1 mm toward origin (cold mass center) Z: moves 1 mm down within coordinate system, origin moves 2 mm toward cold mass center Y: no net movement, heat shield moves 16 mm away from cold mass center within coordinate system, origin moves 16 mm toward cold mass center

6. LBRC – NON-LEAD END INTERFACES

Installation connections needed at the non-lead end are the cold bore tube, the beam screen, the warm-to-cold transition, and the heat shield, MLI blankets, and cryostat.

6.1 COLD BORE TUBE, BEAM SCREEN AND WARM-TO-COLD TRANSITION

CERN will design and provide beam screens and warm-to-cold transitions (WCT), one of each per bore. They will be installed after the magnet arrives at CERN. The spaces indicated in Figure 9 are reserved for the cold bore – beam screen interface (#1 in Figure 9), WCT – heat shield interface (#2), and WCT – vacuum closure interface (#3) are shown.

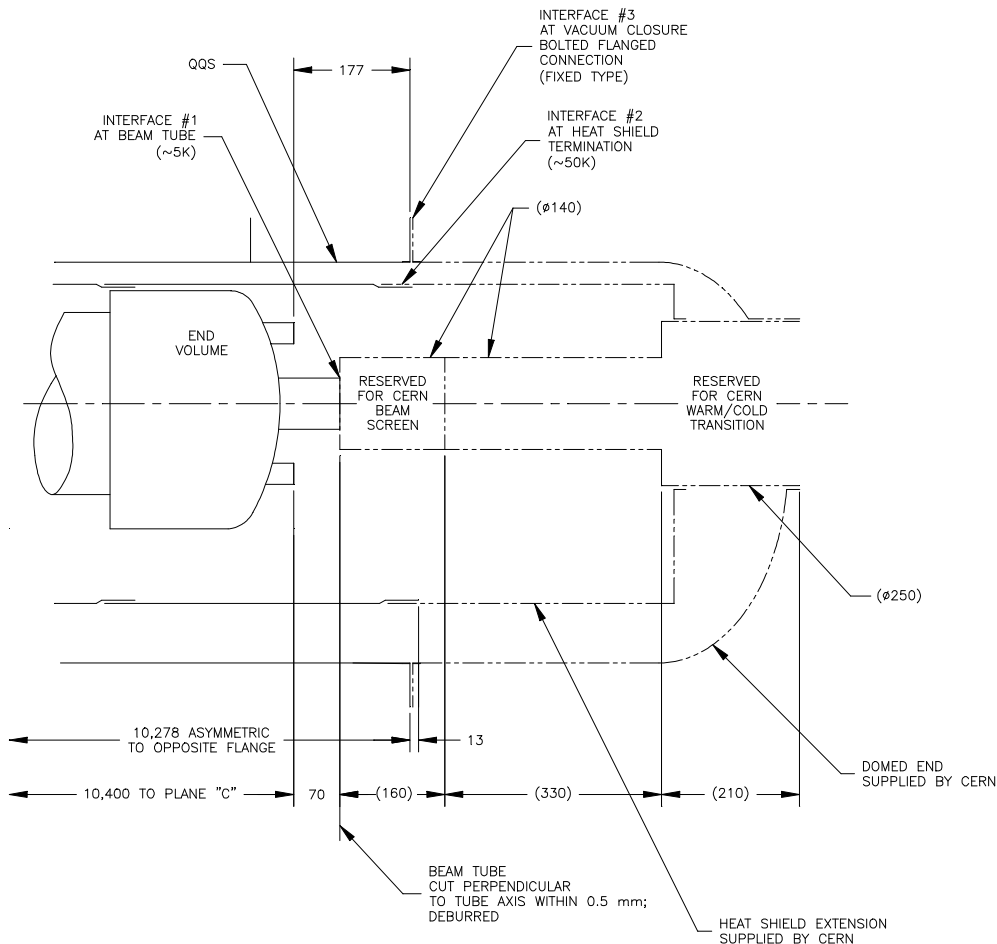


Figure 9 Reserved space for the beam screen interface and warm-to-cold transition.

6.2 TUBE POSITIONS

The warm coordinate positions and tubing diameters of the cold bore tubes and cryostat vacuum flange are given for the left and right sides of the IP in Tables 8 and 9 respectively. The cold Y-coordinate positions are also shown. The cold X- and Z-cold coordinate positions are the same as for the lead end (Tables 2 and 3). The local coordinate system, which is referenced to the lead end volume moves with cooldown as described in Section 3.2.

Table 8 *Coordinate Positions for the D2 non-lead end on the left side of the IP.*

Name	Description	OD x Wall Tube (mm)	Coordinate Positions					
			X (mm)		Z (mm)		Warm Y (mm)	Cold Y (mm)
V1	Cold bore tube, left aperture ^a	73 x 1.9	-94.2	±1	0.0	±1	10470 ±3	10438 ±3
V2	Cold bore tube, right aperture ^a	73 x 1.9	94.2	±1	0.0	±1	10470 ±3	10438 ±3
W	Cryostat (fixed flange beyond QQS)	1055 x 82.5	0.0	±3	-80.0	±3	10577 ±3	10561 ±3

Note a: "Left" and "right" are defined as viewed from lead end.

Table 9 *Coordinate Positions for the D2 non-lead end on the right side of the IP.*

Name	Description	OD x Wall Tube (mm)	Coordinate Positions					
			X (mm)		Z (mm)		Warm Y (mm)	Cold Y (mm)
V1	Cold bore tube, left aperture ^a	73 x 1.9	94.2	±1	0.0	±1	-10470 ±3	-10438 ±3
V2	Cold bore tube, right aperture ^a	73 x 1.9	-94.2	±1	0.0	±1	-10470 ±3	-10438 ±3
W	Cryostat (fixed flange beyond QQS)	1055 x 82.5	0.0	±3	-80.0	±3	-10577 ±3	-10561 ±3

Note a: "Left" and "right" are defined as viewed from lead end.

7. LBRC – TUNNEL FLOOR INTERFACES

Figure 10 is a bottom view of the cryostat, showing the positions of the internal support posts and the recesses which interface with the support jacks. Along the length of the magnet are located three posts supporting the cold mass within the vacuum vessel. They are positioned at the longitudinal center of the vacuum vessel and 141.5 inches (3594 mm) to either side of center. The support posts attach to CERN vacuum vessel castings which are integral to the vessel at the three locations.

To support the cryostatted magnet, CERN "PMPS" jacks will be used between the floor and the bottom surface of the two outboard vacuum vessel castings. The castings (and the CERN-supplied vacuum port covers) are designed with recesses into which BNL will fit GE-45-SX spherical washers to mate with the jacks. Two jacks will be used at one end of the magnet and one jack at the other. The single jack is located below the magnet centerline and interfaces with the recess and washer in the CERN supplied port cover. The jacking points are located coincident with the longitudinal center positions of the posts. The central cold mass support post is reacted by the beam stiffness of the vacuum vessel and is shimmed differently from the end posts to maintain a straight cold mass inside. There is no jack support required to the tunnel floor at this location, although one may be employed at CERN's option during tunnel installation.

The floor jacks are capable of resisting axial loads resulting from unbalanced bellows forces due primarily to the vacuum load. Therefore, these forces are transmitted to the tunnel floor through the jacks rather than reacted to adjacent magnet elements.

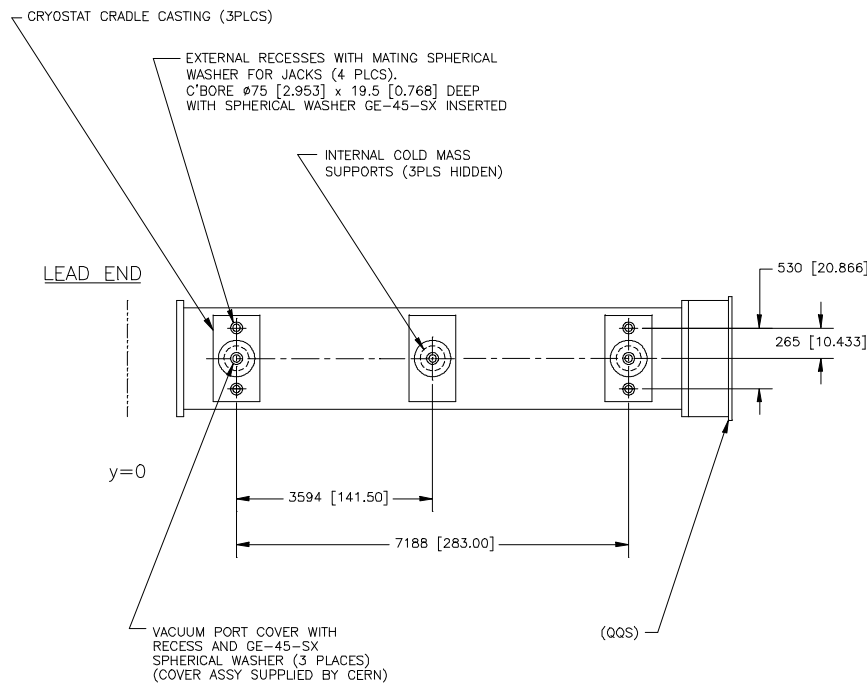


Figure 10 Jack Locations on the bottom of the LBRC cryostat. Dimensions are given in mm [inches].

8. LBRC – ALIGNMENT SYSTEM INTERFACES

The location of the magnetic field center of the cold mass within the vacuum vessel is known by taking measurements of the cold mass fiducials on the shell and on the end volumes during fabrication and transferring these data to cryostat fiducial locations at the Taylor-Hobson (T-H) spheres in accordance with the CERN preferred method of surveying. The cold mass position relative to the T-H spheres will be measured at BNL. The documentation package shipped with each magnet will include the survey information taken during manufacture. The cold mass position can be checked after shipment to CERN by viewing the end volume and T-H fiducials and comparing the measurements with the data supplied by BNL.

The nominal locations of the Taylor-Hobson spheres with respect to the magnetic axis of the dipole magnet are given in Figure 11.

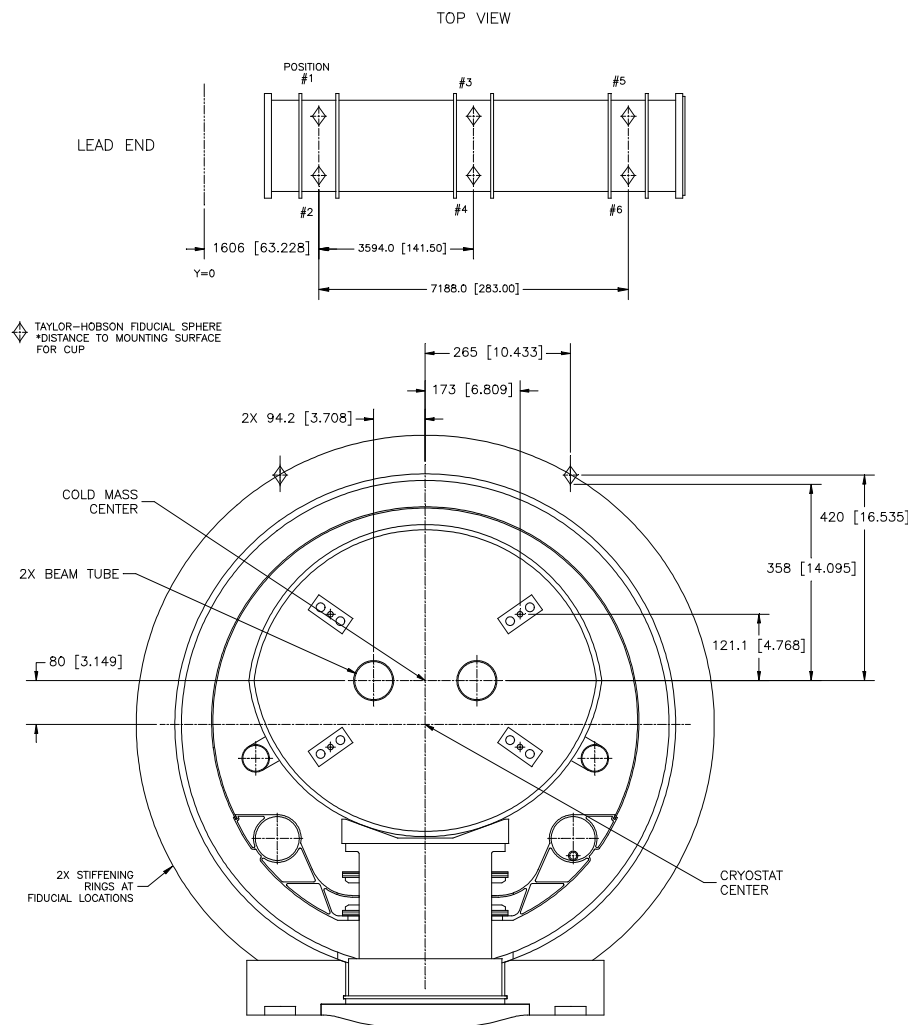


Figure 11 *Fiducial locations on the LBRC cryostat. Dimensions are given in mm [inches].*

9. LIST OF DRAWINGS

	LHC Drawing No.	BNL Drawing No.	Title
[a]	To be assigned	14060007	Magnet Assembly, Tested
[b]	To be assigned	14060008	Magnet Assembly, Cryostatted
[c]	To be assigned	14060010	Assembly, D2 Vacuum Vessel
[d]	To be assigned	14010340	Assembly, Cold Mass
[e]	To be assigned	14010181	Assembly, Electro-Mechanical
[f]	LHCMBX_0003	12130089	Flange, m/c-Pipe
[g]	LHCMBX_0004	14010306	Flange, i-Pipe

10. REFERENCES

- [1] Design Report for the Interaction Region Dipoles and RF Region Dipoles, Brookhaven National Laboratory, September 3, 1999.
- [2] "Superconducting Beam Separation Dipoles: D1 (MBX), D2 (MBRC), D3 (MBRS), D4a (MBRA), D4b (MBRB)", LHC Function Specification, LHC-MBX-ES-0001.00 8 March 1999.
- [3] "Configurations of BNL-built LHC Dipole Magnets", Brookhaven National Laboratory, Magnet Note 586, December 7, 1999.
- [4] BNL Magnet Division Specification, "LHC Dipole Magnet Beam Tube Material," LHC-MAG-M-1010, <http://magnets.rhic.bnl.gov/maps/documents\LHC-MAG-M-1010.pdf>.
- [5] "Design Standards – Mechanical Engineering and Installations", LHC Quality Assurance Standard, LHC-PM-QA-402.00 rev 1.1, 15 November 1999.
- [6] "Arc Cryomagnet Extremities", LHC-LI-ES-0001, rev 2.0, 20 August 1999.
- [7] "Beam Separation Dipole D2 Cooling", LHC Cooling Specification, LHC-MBR-ES-0007.00 (draft)
- [8] "LHC Magnet Polarities", LHC-DC-ES-0001, rev 1.1, 19 June 1999.
- [9] Balle, C., "Mounting of Industrial Type Cryogenic Thermometers", version 2.0, CERN, 19 Feb 1999.